



ORIGINAL INSTRUCTIONS

Instruction Manual

Pilot Operated 2 Port Solenoid Valve

JSXH21D-CH##-##-#-X1



The intended use of this product is to control the downstream fluid supply.

1 Safety Instructions

These safety instructions are intended to prevent hazardous situations and/or equipment damage. These instructions indicate the level of potential hazard with the labels of "Caution," "Warning" or "Danger." They are all important notes for safety and must be followed in addition to International Standards (ISO/IEC) ⁽¹⁾, and other safety regulations.

- ⁽¹⁾ ISO 4414: Pneumatic fluid power - General rules and safety requirements for systems and their components.
 ISO 4413: Hydraulic fluid power - General rules and safety requirements for systems and their components.
 IEC 60204-1: Safety of machinery - Electrical equipment of machines. (Part 1: General requirements)
 ISO 10218-1: Robots and robotic devices - Safety requirements for industrial robots - Part 1: Robots.
- Refer to product catalogue, Operation Manual and Handling Precautions for SMC Products for additional information.
 - Keep this manual in a safe place for future reference.

	Danger	Danger indicates a hazard with a high level of risk which, if not avoided, will result in death or serious injury.
	Warning	Warning indicates a hazard with a medium level of risk which, if not avoided, could result in death or serious injury.
	Caution	Caution indicates a hazard with a low level of risk which, if not avoided, could result in minor or moderate injury.

Warning

- Always ensure compliance with relevant safety laws and standards.
- All work must be carried out in a safe manner by a qualified person in compliance with applicable national regulations.
- If this equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

Caution

- The product is provided for use in manufacturing industries only. This product must not be used in residential areas.

2 Specifications

2.1 Valve specifications

Fluid	Air, Nitrogen, Argon, Oxygen ^{Note 1)}
Body material	Brass
Valve construction	Pilot type diaphragm
Valve type	Normally closed (N.C.)
Orifice diameter \varnothing [mm]	16
Fluid temperature [°C]	-10 to 50
Ambient temperature [°C]	
Withstand pressure [MPa]	6.0
Maximum operating pressure [MPa]	4.0
Flow characteristics	See 2.3 Flow characteristics
Response time [ms] ^{Note 2)}	See 2.4 Response time
Duty cycle	Contact SMC
Maximum operating frequency [Hz]	Contact SMC
Minimum operating frequency	Once every 30 days
Lubrication	Not required
Impact / Vibration resistance [m/s ²] ^{Note 3)}	150 / 30

2 Specifications - continued

Enclosure (based on IEC60529)	IP67 (IP65 for DIN terminal)	
Mounting orientation	Unrestricted	
Seal material	PUR, HNBR	
Weight [g] (Grommet) ^{Note 4)}	Port size	3/8
		1/2
		713
		671

Table 1.

Note 1) Check and understand the Warning and Danger information, use of this valve with oxygen takes full responsibility.

Note 2) Variable dependent on pressure, voltage fluctuation, piping conditions, etc.

Note 3) Impact resistance: No malfunction occurred when it was tested with a drop tester in the axial direction and at right angles to the main valve and armature; in both energized and de-energized states and for every time in each condition. (Values quoted are for a new valve)

Vibration resistance: No malfunction occurred in a one-sweep test between 5 and 2000 Hz. Tests are performed at both energized and de-energized states in the axial direction and at right angles to the main valve and armature. (Values quoted are for a new valve.)

Note 4) Add 20g for the grommet type with PCB, 70g for the conduit type, 50g for the DIN terminal type and 15g for the M12 connector type.

2.2 Valve leakage and operating pressure differential

Body material	Brass
Valve leakage [cm ³ /min] (ANR) ^{Note 1)}	≤ 1
External leakage [cm ³ /min] (ANR) ^{Note 1)}	≤ 1
Minimum operating pressure differential [MPa]	0.15
Maximum operating pressure differential [MPa]	4.0

Table 2.

Note 1) At 20°C ambient temperature and a differential pressure ≥ the minimum operating pressure differential for air.

2.3 Flow characteristics

Port size		3/8	1/2
Flow characteristics	C[dm ³ /(s · bar)]	15	17.7
	b	0.36	0.22
	Cv	3.9	4.3

2.4 Response time

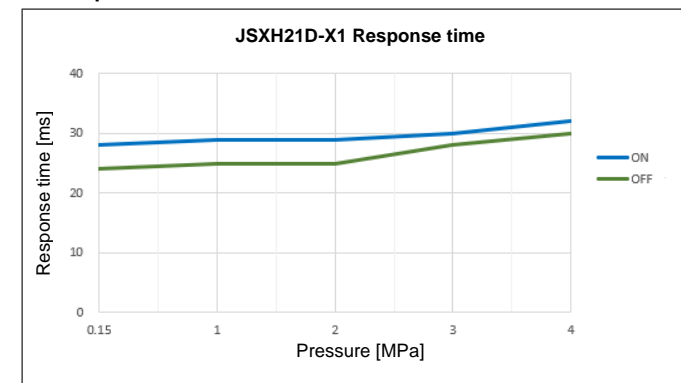


Figure 1. Response time

Note) Response times recorded with air and 24VDC power supply.

2.5 Coil specifications

Rated voltage [V] ^{Note 1)}	AC	24, 48, 100, 110, 120, 200, 220, 240
	DC	12, 24
Electrical entry	Grommet, Conduit, DIN terminal, M12 connector	
Coil insulation type	Class B	
Allowable voltage fluctuation	±10% of rated voltage	
Allowable leakage voltage	AC	5% or less of rated voltage
	DC	2% or less of rated voltage
Apparent power [VA] ^{Note 2), 3)}	AC	8
Power consumption [W] ^{Note 2)}	DC	6
	AC	70
Temperature rise [°C] ^{Note 4)}	AC	70
	DC	65

Table 3.

Note 1) Grommet is only for DC voltage. Grommet with PCB, only for DC voltage and AC 24, 48, 100V.

Note 2) Apparent power / Power consumption: The value at ambient temperature of 20°C and when rated voltage is applied (Variation: ± 10%).

Note 3) There is no difference in the frequency and the inrush and energised apparent power, since a rectifying circuit is used in the AC.

2 Specifications - continued

Note 4) Temperature rise is the increase when rated voltage is applied to a valve with an ambient temperature of 20°C. However, it is a reference value because it varies depending on the surrounding environment.

3 Installation

3.1 Installation

Warning

- Do not install the product unless the safety instructions have been read and understood.

3.2 Environment

Warning

- Do not use in an environment where corrosive gases, chemicals, salt water or steam are present.
- Do not use in an explosive atmosphere.
- Do not expose to direct sunlight. Use a suitable protective cover.
- Do not install in a location subject to vibration or impact in excess of the product's specifications.
- Do not mount in a location exposed to radiant heat that would result in temperatures in excess of the product's specifications.
- Products compliant with IP65 and IP67 enclosures are protected against dust and water, however, these products cannot be used in water.
- Products compliant with IP65 and IP67 enclosures satisfy the specifications by mounting each product properly. Be sure to read the Specific Product Precautions for each product.
- For low temperature operation, take appropriate measures to prevent solidification or freezing of drainage and moisture, etc.
- In case of use in environments such as cold regions, high dew point temperature with low ambient temperature and high flow rates:
 - Drain water from pipeline when equipment is off.
 - Apply thermal insulating material or use a heater, etc (avoid on coil portion).
- Employ suitable protective measures in locations where there is contact with oil or welding spatter, etc.
- Do not use in high humidity environment where condensation can occur.

3.3 Piping

Caution

- For the handling of our fittings, please refer to Fittings and Tubing Precautions in the Handling Precautions for SMC products.
- When using fittings other than SMC fittings, follow the instructions given by the fitting manufacturer.
- Tightening torque for steel pipe piping. When piping to the valve, tighten with the following appropriate torque:

Port size	Tightening torque [N·m]
3/8	22 to 24
1/2	28 to 30

Table 4.

- Before connecting piping make sure to clean up chips, cutting oil, dust etc.
- When installing piping or fittings, ensure sealant material does not enter inside the port. When using seal tape, leave 1.5 to 2 threads exposed on the end of the pipe/fitting.
- Avoid connecting ground lines to piping, as this may cause electric corrosion of the system.
- When connecting piping to the product, avoid mistakes regarding the supply ports etc.
- When connecting tubes using the one-touch fitting, provide tube length with sufficient margin. Refer to Specific Precautions in the catalogue for more details.
- When connecting piping/fitting to the valve, clamp the valve body. See Figure 2.

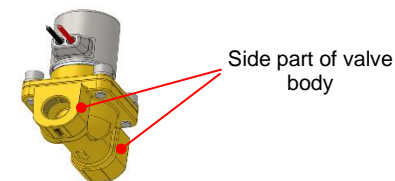


Figure 2. Clamp area of valve

3 Installation - continued

Warning

- To prevent uncontrolled tube movement, install protective covers or fasten tubes securely in place.
- If using tube piping, secure the product to a permanent fixture. Do not suspend it by the tubing.

3.4 Lubrication

Caution

This product does not require lubrication in service.

3.5 Fluid supply

Warning

- The use of a fluid that contains foreign objects can cause problems such as malfunction and seal failure by promoting wear of the valve seat and armature and by sticking to the sliding parts of the armature etc. Install a suitable filter (strainer) immediately upstream from the valve. Filtration size is 5µm or less for air.

Warning

- If there is a possibility of back pressure being applied to the valve, take countermeasures such as mounting a check valve on the downstream side of the valve.

3.5.1 Air, Nitrogen, Argon

Warning

Use clean air. If the compressed air supply includes chemicals, synthetic materials (including organic solvents), salinity, corrosive gas etc., it can lead to damage or malfunction.

Caution

- Compressed air that includes drainage may cause malfunction of valves and other pneumatic equipment. To prevent this, install an air dryer or after cooler, etc.
- If excessive carbon powder is generated by the compressor, it may adhere to the inside of the valves and cause a malfunction. Install mist separators upstream of the valves to eliminate it.
- When operating air with a dew point of -70°C or lower, the inside of the valve may wear, and the product life will be shortened.

3.5.2 Oxygen

Danger

As oxygen gas is a combustion enhancing gas, it ignites by frictional heat or static electricity, and burns the metal and seal materials. Therefore, the following instructions should be followed strictly.

- Perform air flushing and install a proper filter in the pipe, so that metal chippings or fine particles do not enter the product.
- In the unlikely event that an abnormality occurs, take safety measures such as installing a safety circuit (circuit for stopping the supply of oxygen gas, etc.) in consideration of fires, explosions, etc.

3.6 Mounting

Warning

- Ensure sufficient space for maintenance activities.
- Avoid sources of vibration or adjust the distance from the body to a minimum length so that resonance will not occur.
- Do not apply external force to the coil section: When tightening fittings, apply a wrench or other tool to the outside of the piping connection parts.
- Do not warm the coil assembly with a heat insulator, etc. Use tape, heaters, etc, for freeze prevention on the piping and body only. They can cause the coil to burn out.
- Valve becomes hot during and after energization. Do not touch it with bare hands as it may cause burns.

Caution

- Painting and coating: Warnings or specifications printed or labelled on the product should not be erased, removed or covered up.

3.7 Electrical connection

Warning

- The solenoid valve is an electrical product. For safety, install an appropriate fuse and circuit breaker before use according to local regulations. When using a number of solenoid valves, installing one fuse on the primary side is not enough. To protect the device more safely, select and install a fuse for each circuit.

3 Installation - continued

Caution

- Avoid mis-wiring, as this can cause malfunction and damage to the product.
- Use electrical wire with cross sectional area 0.5 to 1.25 mm².
- Use electrical circuits that do not generate chattering in their contacts.
- When a surge from the solenoid affects the electrical circuitry, install a surge absorber, etc., in parallel with the solenoid or use the product with a surge voltage suppressor.
- Use voltage that is within ±10% of the rated voltage. In case of direct current, if the response time is important, ensure that voltage is within ±5% of the rated value. (The voltage drop is the value in the lead wire section connecting the coil.)
- Do not bend or pull lead wires and cables repeatedly.
- Do not apply more than 10 N of force to the lead wires or damage may occur.
- Do not bend the lead wires beyond 90° with a radius of less than 20mm or damage may occur. See Figure 3.




Figure 3. Lead wire bending

3.7.1 Grommet (Lead wire AWG20, outer diameter 2.6mm.)

Voltage type	Lead wire colour	
	1	2
Grommet	DC (12,24 V)	Black / Red
Grommet with PCB	DC (12, 24 V)	Black / Red
	AC (100 V)	Blue / Blue
	AC (24,48 V)	Grey / Grey

Table 5.

Note) There is no polarity.

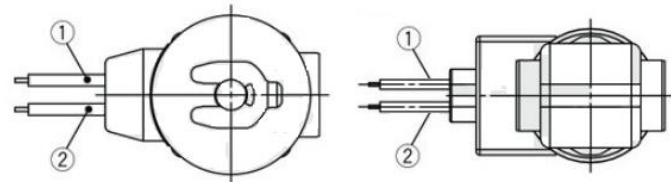


Figure 4. Grommet and grommet with PCB

3.7.2 Conduit (Lead wire AWG18, outer diameter 2.8mm.)

Voltage type	Conduit wire colour		
	1	2	3 (ground wire)
DC	Black	Red	Green / Yellow
AC 100V	Blue	Blue	Green / Yellow
AC 200V	Red	Red	Green / Yellow
Other AC	Grey	Grey	Green / Yellow

Table 6.

Note) There is no polarity.


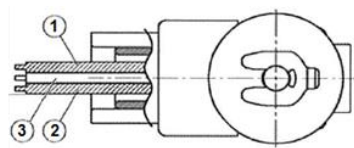


Figure 5. Conduit

3 Installation - continued

3.7.3 DIN terminal

- Use a cord with an outside cable diameter of Ø6 to Ø12 mm.
- Tighten screws and fittings according to Figure 6.
- If an outside cable diameter of Ø9 to Ø12 mm is used, remove the internal parts of the rubber seal before using.
- Conforms to DIN EN 175301-803, 18 mm, Form A.

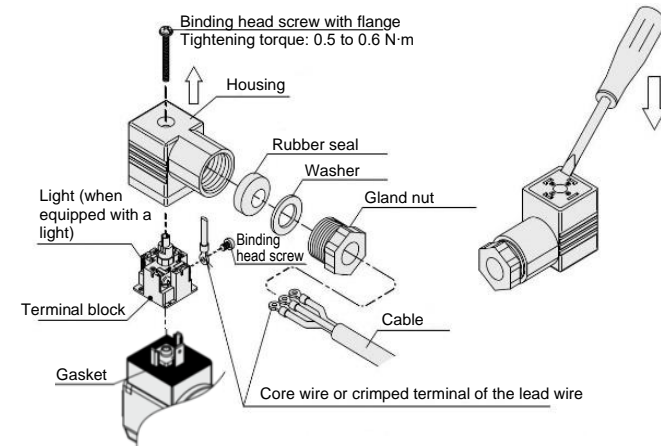

Note) The light position is fixed regardless of the electrical entry direction.




Figure 6. DIN terminal - Form A

Caution

Internal connections are shown below. Make connections to the power supply accordingly.

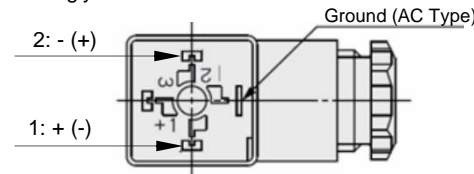


Figure 7. DIN connector pins

Note) There is no polarity.

Contact	1	2
DIN Terminal	+ (-)	- (+)

Table 7.

3.7.4 M12 connector

Valve side			
DC (non-polar)		AC	
2. Unused	1. Unused	2. Unused	1. Ground
3. Power	4. Power	3. Power	4. Power
Cable side			
DC (non-polar)		AC	
1. Unused	2. Unused	1. Ground	2. Unused
4. Power	3. Power	4. Power	3. Power

Table 8.

3 Installation - continued

M12 connector wire colour			
1	2	3	4
Brown	White	Blue	Black

Table 9.

Caution

- The valve achieves IP67 rating when used with IP67 rated female connector (with cable). Note that the valve shouldn't be used in water.
- Tighten the connector by hand (at 0.39 to 0.49 N·m), not with a tool which may damage the connector.
- Do not apply repeated bending force, tensile force or heavy load to the cable.
- Do not pull the connector or cable unnecessarily.
- When installing the valve, do not bend the cable at the root from the connector body.

3.8 Electrical circuits

Caution

Surge suppression should be specified by using the appropriate part number. If a valve without suppression (Type 'G') is used, suppression must be provided by the host controller as close as possible to the valve.

3.8.1 DC circuits

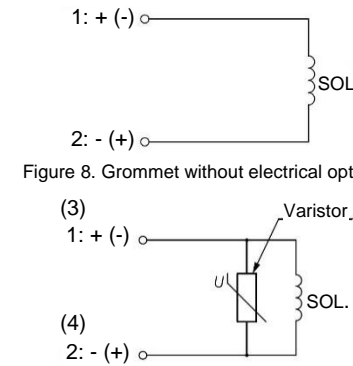


Figure 8. Grommet without electrical option

Figure 9. Grommet / DIN terminal / Conduit with surge voltage suppressor / M12 connector (3,4)

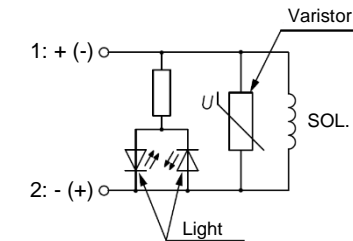


Figure 10. DIN terminal with light and surge voltage suppressor

3.8.2 AC circuits

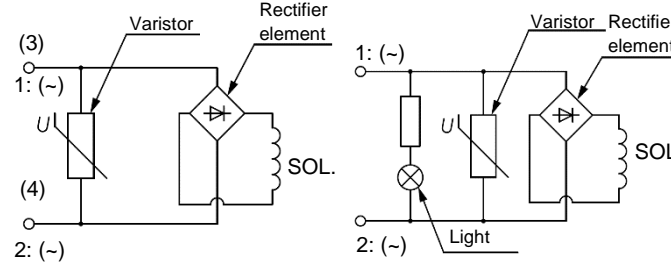


Figure 11. Grommet / DIN terminal / Conduit with surge voltage suppressor / M12 connector (3,4)

Caution

- If a varistor or diode surge voltage suppressor is used, the suppressor arrests the back EMF voltage from the coil to approximately 1 V (AC type) or 60 V (DC type).
- Ensure the transient voltage is within the specification of the host controller.
- Valve response time is dependent on surge suppression method selected.

3 Installation - continued

3.10 Countermeasure for external surge voltage

Caution

- At times of sudden interruption of the power supply, the energy stored in a large inductive device may cause non-polar type valves in a de-energised state to switch.
- When installing a breaker circuit to isolate the power, install a surge absorption diode across the output of the breaker.

3.11 Extended period of continuous energization

Warning

- The solenoid coil will generate heat when continuously energized, so avoid installing in an enclosed space. Install in a well-ventilated area.
- Do not touch the coil while it is being energized or immediately after energization.

4 How to Order

Refer to catalogue for 'How to Order' or to product drawings for special products.

5 Outline Dimensions

Refer to special drawings for outline dimensions.

6 Maintenance

6.1 General maintenance

Caution

- Not following proper maintenance procedures could cause the product to malfunction and lead to equipment damage.
- If handled improperly, compressed fluids can be dangerous. Shut off the fluid supply and release the fluid pressure in the system.
- Make sure that temperature of the valve has reduced sufficiently before removing the valve.
- After installation and maintenance, apply operating pressure and power to the equipment and perform appropriate functional and leakage tests to make sure the equipment is installed correctly. If leakage increases or equipment does not operate properly, stop operation.

- If any electrical connections are disturbed during maintenance, ensure they are reconnected correctly, and safety checks are carried out as required to ensure continued compliance with applicable national regulations.
- Do not make any modification to the product.
- Do not disassemble the product, unless required by installation or maintenance instructions.
- Switch valves at least once every 30 days to prevent malfunction. Also, in order to use it under the optimum state, conduct a regular inspection once every 6 months.

6.2 Replacement parts

Contact SMC.

6.3 How to replace solenoid coil

Warning

- When replacing the solenoid coil, turn off the power supply.
- Be careful of possible high temperature of the solenoid coil due to the fluid temperature and operating conditions.


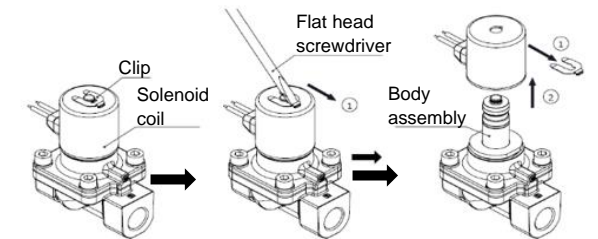


Figure 13.

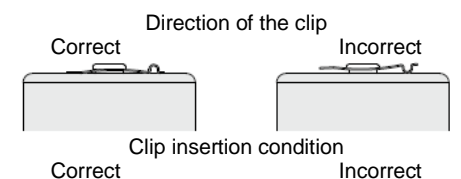

6 Maintenance - continued



Figure 14.

Note) When inserting the coil, be sure to push it in until the groove in the body assembly is visible.

7 Limitations of Use

Warning

The system designer should determine the effect of possible failure modes of the product on the system.

7.1 Limited warranty and disclaimer/compliance requirements

Refer to Handling Precautions for SMC Products.

Warning

7.2 Effect of energy loss on valve switching

Fluid supply present, electrical supply cut	Valve returns to the initial de-energised position by fluid and spring force
Electrical supply present, fluid supply cut	Valve remains in the energised position.

Table 10.

7.3 Low temperature operation

- The valve can be used in an ambient temperature of -10°C . However, take measures to prevent freezing or solidification of impurities, etc.
- A high dew point in low ambient temperature or a high flow rate may cause freezing. In such cases, take measures to prevent freezing by, for example, installing an air dryer or keeping the body warm.

7.4 Holding of pressure

Since valves are subject to air leakage, they cannot be used for applications such as holding pressure (including vacuum) in a system.

7.5 Cannot be used as an emergency shut-off valve

This product is not designed for safety applications such as an emergency shut-off valve. If the valves are used in this type of system, other reliable safety assurance measures should be adopted.

7.6 Normally closed valves

Warning

Although the valves are normally closed (IN and OUT port blocked), and flow is blocked from Port 1 to Port 2, the fluid will not be blocked if Port 2 pressure is greater than Port 1 pressure, and fluid will flow from Port 2 to Port 1.

Caution

7.7 Leakage voltage

Ensure that any leakage voltage caused by the leakage current when the switching element is OFF causes $\leq 2\%$ of the rated voltage across the valve for DC coil and $\leq 5\%$ for AC coils.

7.8 Fluids

- The compatibility of the components of this product with the fluid used may vary depending on the type of fluid, additives, concentration, temperature, etc. Check the compatibility with the actual machine before use.
- Take measures to prevent static electricity since some fluids can cause static electricity.
- Do not use the product with the fluids listed below:
 - Fluids that are harmful to the human body.
 - Combustible or flammable fluids.
 - Corrosive gas and fluid.
 - Sea water, saline.

7.9 EMC restrictions

7.9.1 Class and group description

- This product is group 1, class A equipment according to EN55011.
- Group 1 equipment does not intentionally generate radio-frequency energy in the range 9 kHz to 400 GHz.
- Class A equipment is equipment suitable for use in all locations other than those allocated in residential environments and those directly connected to a low voltage power supply network which supplies buildings used for domestic purposes.

7 Limitations of Use - continued

- This equipment is not intended for use in residential environments and may not provide adequate protection to radio reception in such environments.

8 Product Disposal

This product shall not be disposed of as municipal waste. Check your local regulations and guidelines to dispose this product correctly, in order to reduce the impact on human health and the environment.

9 Return of Product

Warning

If the product to be returned is contaminated or is possibly contaminated with substances that are harmful to humans, for safety reasons, please contact SMC beforehand and then employ a specialist cleaning company to decontaminate the product. After the decontamination prescribed above has been carried out, submit a Product Return Request Sheet or the Detoxification/Decontamination Certificate to SMC and await SMC's approval and further instructions before attempting to return the item. Please refer to the International Chemical Safety Cards (ICSC) for a list of harmful substances. If you have any further questions, please don't hesitate to contact your SMC sales representative.

10 Contacts

Refer to www.smcworld.com or www.smc.eu for your local distributor/importer.

SMC Corporation

URL : <https://www.smcworld.com> (Global) <https://www.smc.eu> (Europe)
 SMC Corporation, 4-14-1, Sotokanda, Chiyoda-ku, Tokyo 101-0021, Japan
 Specifications are subject to change without prior notice from the manufacturer.
 © SMC Corporation All Rights Reserved.
 Template DKP50047-F-085M